


NOTE:
THE TOTAL RESISTANCE OF THE GROUND CONNECTION
FROM THE DETECTOR TO THE AMPLIFIER CAN
NOT EXCEED 1 OHM

* ADD JUMPER TO CONNECT
SHIELDED TERMINALS

FOR INSTALLATION IN CANADA, FOLLOW THE
CANADIAN ELECTRICAL CODE (CEC), C22.1

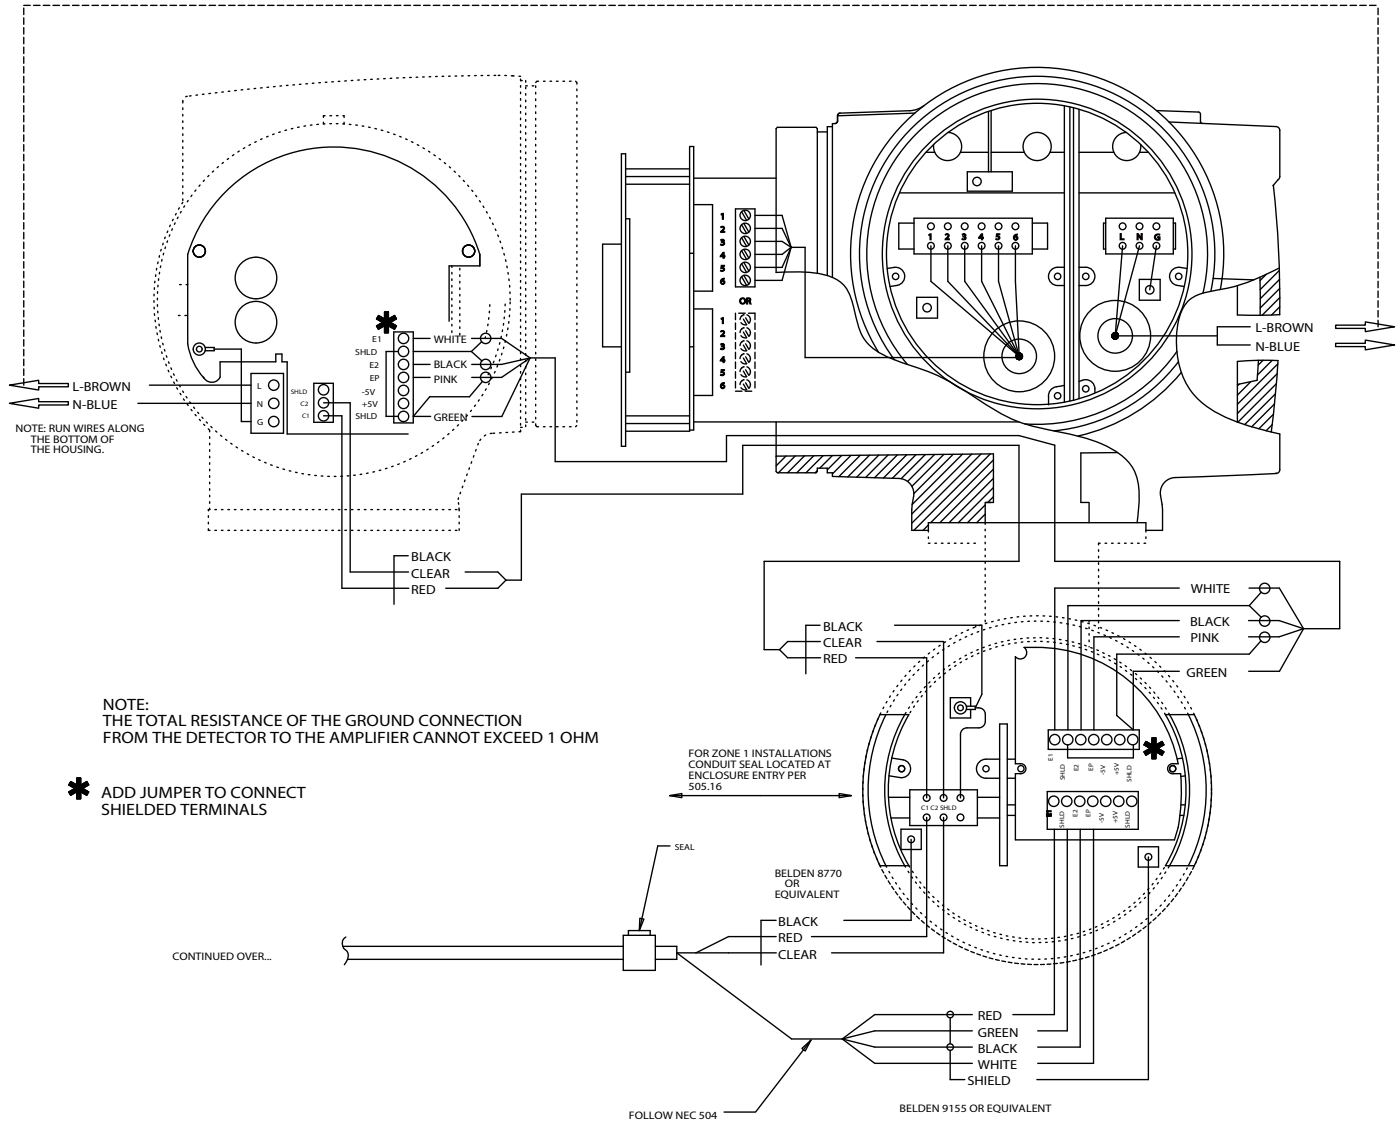

Control. Manage. Optimize.

ModMAG is a registered trademark of Badger Meter, Inc. Other trademarks appearing in this document are the property of their respective entities. Due to continuous research, product improvements and enhancements, Badger Meter reserves the right to change product or system specifications without notice, except to the extent an outstanding contractual obligation exists. © 2021 Badger Meter, Inc. All rights reserved.